

U1602, U1603

ECS ENERGY • CONTROL • SYSTEM

3-349-046-03
3/6.09

- **64 processing channels**
physical inputs or LON meter outputs can be assigned for the calculation of energy, power and costs
- **Energy Control Language**
for the programming of analysis, monitoring and optimization applications
- **LON interface** for 63 LON devices
- **Two RS 232 interfaces (115 kBit/s)**
for connection to PC, modem, printer or radio-controlled clock
- **Two ECS LAN interfaces**
for the linking of individual summators over great distances
- **Simple software update via serial interface (Flash)**



U1603:

- **6 universal inputs:** ± 5 mA, ± 20 mA, ± 10 V, S0 pulse
- **2 analog outputs:** ± 20 mA or ± 10 V
- **2 relays and 4 MOS switches** for controlling external processes

QUALITY MANAGEMENT SYSTEM



DQS certified per
DIN EN ISO 9001 Reg. No.1262



Applications

The U1602 micro-summator and the U1603 mini-summator are used as PC adapters or LON interfaces for the ECS LAN, and are not equipped with any display or operating elements. Inputs and outputs expand the U1603 mini-summator into a miniature data collector and optimization unit.

Meter Inputs

Up to 63 LON devices can be connected to the U1602 micro-summator or the U1603 mini-summator via the easy-to-wire, polarity-reversal-protected, electrically isolated LON interface:

- Multifunctional power meter A2000
- Programmable multi-measuring transducer DME 400
- Electricity meter U1681, U1687, U1689, U128x W1, U138x W1
- Meter reading module U1660
- Analog input module U1661
- Relay output module OCL210 by Littwin

Analysis

All relevant energy and consumption data are logged over defined time periods at a programmable interval via 64 processing channels and are stored to memory as load profiles along with the corresponding maximum values.

Beyond this, the U1603 mini-summator is also capable of processing analog or pulse signals via six input channels with configurable parameters.

Operation

The U1603 is equipped with two analog outputs, four MOS switches and two relays (changeover contacts) for the control of external processes. Data exchange with a PC, as well as remote querying via modem are accomplished via the RS 232 interface (115 kBit / s). A radio-controlled clock for the synchronization of system time, as well as a report printer, can also be connected.

Networking

Individual summators can be linked into a network over great distances with the multi-master compatible **ECS LAN** with free selection of network topology, and have unrestricted access to all data available from each of the network users.

Universal Application

Both the U1602 micro-summator and the U1603 mini-summator are suitable for customer-specific calculations, analyses, monitoring and optimization thanks to integrated high-level intelligence and the system-specific ECL programming language - even independent of the Energy Control System.

Variable Installation

The compact housing and IP protection have been laid out for rugged industrial use, and the modules can be mounted to top-hat rails in accordance with EN50022. They can also be mounted with screws, or integrated into the control cabinet. Installation is user-friendly and easy with plug-in screw terminals.

U1602, U1603

ECS ENERGY • CONTROL • SYSTEM

Applicable Regulations and Standards

EN 61010-1	Safety requirements for electrical equipment for measurement, control and laboratory use
DIN 43864	Current interface for pulse transmission between impulse meters and tariff devices
VDE 0470 Part 1	IP protection provided by enclosures (DIN 40050)
IEC 68 Part 2-6	Basic environmental test procedure Sinusoidal oscillation
UL 94	Test for flammability of plastic materials for parts in devices and appliances
EMC Standards	see Technical Data

Symbols and their Meanings

Symbol	Meaning
X	Measured quantity, analog input
X2	Upper range value of measured quantity
Y	Output quantity, analog output
Y2	Upper range value of output quantity

Memory Capacities per Channel

Energy

Cumulative Energy as of a Defined Starting Time	
E tot	Independent of tariff
E tot T1	For tariff 1 only
E tot T2	For tariff 2 only
E tot T1T2	For tariff 1 + tariff 2
Cumulative Energy for Defined Time Periods	
E Day	For current day and each of the last 10 days
E Month	For current month and each of the last 12 months
E Year	for current year and each of the last 4 years
E Int	For all stored measuring intervals (measurement data list)
Maximum Values for Measuring Intervals, with Date and Time Stamp	
E maxInt	The 10 highest values for all measuring intervals as of a defined starting time
E maxDay	Maximum value for the current day, and for each of the last 10 days
E maxMonth	Maximum daily value for the current month, and for each of the last 12 months
E maxYear	Maximum value for the current year, and for each of the last 4 years

Costs

Cumulative Costs as of a Defined Starting Time	
CostT1	For tariff 1 only
CostT2	For tariff 2 only
CostT1T2	For tariff 1 + tariff 2

Power

Instantaneous Power	
P mom	Determined from the time interval between the last two pulses (with connection to E1 ... E12)
Mean Values for Measuring Intervals	
P int	For all stored measuring intervals (measurement data list)
Maximum Values for Measuring Intervals, with Date and Time Stamp	
P maxInt	The 10 highest values from all measuring intervals as of a defined starting time
P maxDay	Maximum value for the current day, and for each of the last 10 days
P maxMonth	Maximum daily value for the current month, and for each of the last 12 months
P maxYear	Maximum value for the current year, and for each of the last 4 years

Technical Data

Inputs (U1603)

The 6 inputs can be configured individually with the DIP switches.

Analog Input (Current)	
Input quantity	direct current
Design	electrically isolated
Input range	$-X2 \leq X \leq +X2$
Upper range value X2	5 mA/20 mA
Max. input current	$\leq 2.5 X2$
Control limit	$\pm 1.25 X2$
Input resistance	
X2: 20 mA	75 Ω
X2: 5 mA	300 Ω
Common mode rejection	≥ 80 dB (≤ 120 Hz)

Analog Input (Voltage)	
Input quantity	direct voltage
Design	electrically isolated
Input range	$-X2 \leq X \leq +X2$
Upper range value X2	10 V
Max. input voltage	≤ 30 V
Control limit	$\pm 1.25 X2$
Input resistance	118 k Ω
Common mode rejection	≥ 80 dB (≤ 120 Hz)

Binary Input	
Input quantity	direct voltage (square-wave pulses, SO compatible)
Design	electrically isolated
Operating point (adjustable)	signal level: L: 0.5/1.25/2.5/3.5 mA
Max. input voltage	
continuous	≤ 48 V
intermittent ($t \leq 1$ s)	≤ 60 V
Series impedance (internal)	4.7 k Ω
Allowable switching elements	semiconductor switches, relays
Pulse duration T_{on} (adjustable)	10 ... 2550 ms
Interpulse period T_{off}	≥ 2 ms
Pulse frequency	≤ 250 Hz

Outputs:

The 2 analog outputs can be configured individually with the DIP switches.

Analog Output (Current) (U1603)	
Output quantity	direct current
Design	electrically isolated
Output range	$-Y2 \leq Y \leq +Y2$
Upper range value Y2	20 mA
Max. output voltage	$\leq 30 \text{ V}$
Max. output current	$\leq 25 \text{ mA}$
Load range	$0 \leq 250 \Omega \leq 400 \Omega$

Analog Output (Voltage) (U1603)	
Output quantity	direct voltage
Design	electrically isolated
Output range	$-Y2 \leq Y \leq +Y2$
Upper range value Y2	10 V
Max. output voltage	$\leq 12.5 \text{ V}$
Max. output current	$\leq 40 \text{ mA}$
Load range	$2.5 \text{ k}\Omega \leq 5 \text{ k}\Omega < \infty$
Alternating component	0.5 %

Switching Output (Binary) (U1603)	
Switching element	semiconductor relay
Design	electrically isolated, passive
Number	4
Switching voltage	$\leq \pm 50 \text{ V}$
Switching current	
ON	$\leq 200 \text{ mA}$
OFF	$\leq 10 \mu\text{A}$
Volume resistance (AC/DC)	5Ω

Switching Output (Relay) (U1603)	
Switching element	relay (changeover contact)
Design	electrically isolated
Number	2
Switching voltage	250 V~, 30 V=
Switching current	8 A resistive, 3 A inductive
Operating cycles	$\leq 10^5$

Power Supply For External Switching Contacts	
Voltage U_V (electrically isolated)	24 V =
Voltage tolerance	$\leq \pm 4 \%$
Current (short-circuit and idling proof)	$\leq 0.15 \text{ A}$
Alternating component ($\leq 100 \text{ kHz}$)	$\leq 2 \%$

RS 232 Interface (PC / Printer)

Number	1 (channel A and channel B)
Connectors	plug connector, sub miniature D9 plug
Possible Connections channel A	ECL, modem, terminal, radio-controlled clock
Possible Connections channel B	ECL, printer, radio-controlled clock
Number of data bits	8
Transmission speed COM1/ COM2:	1200 ... 115000 bit/s
Parity	even / no check
Operating Mode	FDX handshake Xon / Xoff or RTS / CTS

ECS LAN Interface (For Linking Summators) (RS 485)

Number	2
Connectors	threaded plug connector (up to 255 users)
Users per segment	16 (32 with loop resistance $< 100 \Omega$)
Operating mode	multi-master, HDX or FDX
Data protocol	HDLC/SDLC (adapted to multi-master requirements)
Topology (line and/or open ring)	$\leq 1200 \text{ m}$ open ring $\leq 100 \text{ m}$ mix
Transmission (hamming distance = 4)	15.6 ... 375 kbps
Status display	2 LEDs
Matching resistors	can be activated

LON Interface (for Connecting Meters)

Number	1 (FTT-10, twisted pair wires)
Connectors	threaded plug connector (up to 63 users per summator)
Operating mode	LonTalk protocol (CSMA)
Cable lengths	wiring as desired $\leq 500 \text{ m}$ bus, terminated $\leq 2700 \text{ m}$ with special cable
Transmission speed	78 kbps
Status display	1 LED, LON active
Bus termination	can be activated 50/100 Ω

Measurement Value Storage

Storage mode	continuous
Memory depth	with 1 channels: 87380 entries with 64 channels: 3971 entries
Memory life span	with backup battery ≥ 5 years (see also auxiliary power supply - backup battery)
Resetting of meters to zero	via PC

Time and Date Clock

Smallest unit of measure	1 s
Admissible deviation	10 ppm = 5.3 min per year

Functions Monitoring

Status display	with LED at front panel
Status relay	changeover contact
Switching voltage	250 V ~, 30 V =
Switching current	8 A resistive, 3 A inductive
Operating cycles	$\leq 10^5$

U1602, U1603

ECS ENERGY • CONTROL • SYSTEM

Electromagnetic Compatibility

Product standard	EN 61326-1:1997/A1: 1998, industrial range	
Interference emission	EN 55022:1998 class A	
Interference immunity	EN 61000-4-2:1995	4 kV contact, 8 kV atmosphere Feature B
	EN 61000-4-3:1996+A1:1998	10 V/m Feature A
	EN 61000-4-4:1995	Feature B
	EN 61000-4-5:1995	mains cable: 1 kV sym., 2 kV asym. signal cable: 1 kV asymmetrical Feature A
	EN 61000-4-6:1996	3 V/m Feature B
EN 61000-4-11:1994	Feature A	

Transmission Behaviour

Accuracy class	(with reference to the upper range value)	
Analog input/output	0.25 % (U1603)	
Binary input/output	±1 pulse (U1603)	
Cycle time	analog meas. channels	≤ 2 ms
	LON 1 channel	≤ 1 s
	LON 64 channels	≤ 10 s

Influencing Quantities and Influence Error (U1603)

Influencing Quantity	Nominal Range of Use	Allowable Influence Error as Percentage of Accuracy Class
Temperature	10 °C ... <u>22 - 24</u> ... 40 °C	50%
	0 °C ... <u>22 - 24</u> ... 55 °C	100%
Output load	load range	20%
Auxiliary power	nominal range of use	10%

Resistance to Climatic Conditions

Relative humidity	75 %, no condensation allowed	
Temperature range	Operation/function	-10 °C ... +55 °C
	Storage, transport	-25 °C ... +70 °C
Elevation	up to 2000 m	

Electrical Safety

Protection class	I per EN 61010-1:1993/A2:1995
Overvoltage category	III
Nominal insulation voltage:	
Input	50 V
Output: analog, binary, Uv	30 V
Output: relay	250 V
Interfaces	50 V
AC Auxiliary Power	265 V
DC Auxiliary Power	80 V
Test voltages:	
Input - housing	0.5 kV
Input - output	0.5 kV
Auxiliary voltage - input	3.7 kV
Input - relay	3.7 kV

Auxiliary Power Supply

Broad Range Input, AC - DC	
Nominal range of use, AC (45 ... 420 Hz)	85 V ... 264 V
Nominal range of use, DC	100 V ... 280 V
Power consumption	≤ 15 W (25 VA)
Fuse	2 A slow-blow
Direct Voltage Input (optional)	
Nominal range of use, DC	20 V ... 72 V
Power consumption	≤ 15 W
Fuse	2 A slow-blow
Backup Battery	
Lithium cell (replaceable without tools and without data loss)	CR 2450
Service life without auxiliary power at 20° C	≥ 5 years
Capacity loss after 5 years with auxiliary power at 20° C	≤ 15%

Mechanical Design

Housing material	aluminum sheet
Dimensions	212 x 125 x 85 mm
Installation position	as desired
Mounting	top-hat rail per EN 50022 / 35 mm, or screw-mounted to plate
Protection	housing: IP 40 terminals: IP 20
Weight	1.6 kg

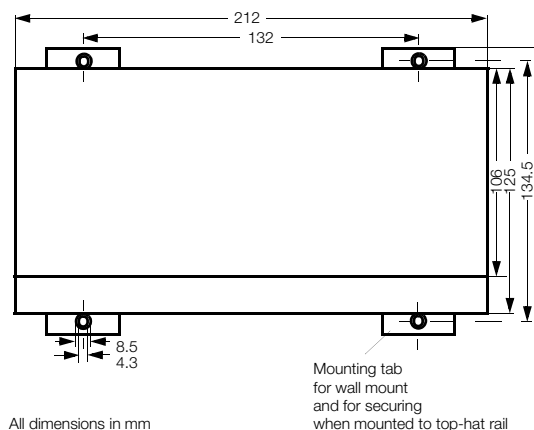




Figure 1 Dimensions

U1602, U1603

ECS ENERGY • CONTROL • SYSTEM


Meter Input and Output Configuration (U1603)

The analog inputs and outputs can be matched to the desired measuring range with the DIP switches. The respective upper limit value for any given range is configured with the help of the firmware.




COM1 Pin Assignments for Sub Miniature D9 Plug

Pin Number	Function
1	DCD
2	RXD
3	TXD
4	
5	signal-ground
6	
7	RTS
8	CTS
9	



COM2 Pin Assignments for Sub Miniature D9 Plug

Pin Number	Function
1	
2	RXD
3	TXD
4	
5	signal-ground
6	
7	RTS
8	CTS
9	



The cable with the designation Z5232000R0001 must be used for connecting a PC or a terminal.

Micro and Mini-Summatom Configuration

Communications and parameters configuration for the U1602 micro-summatom and the U1603 mini-summatom are accomplished with ECSwin software.

Configuration of the U1602 micro-summatom and the U1603 mini-summatom is clearly structured. Differentiation is made amongst five different parameters groups (see figure 2, setup parameters).

"General" parameters are used to configure the summatom and are thus superordinate in nature, whereas the "channel-specific" parameters are directly related to the individual channels.

The "RS 232" and "ECS LAN" parameter groups relate to the serial interface (RS 232) and the ECS LAN system bus (Energy Control System local area network).

A six character password is used to protect individual parameters against unauthorized modification.

Basic Configuration

Setup Parameters Overview

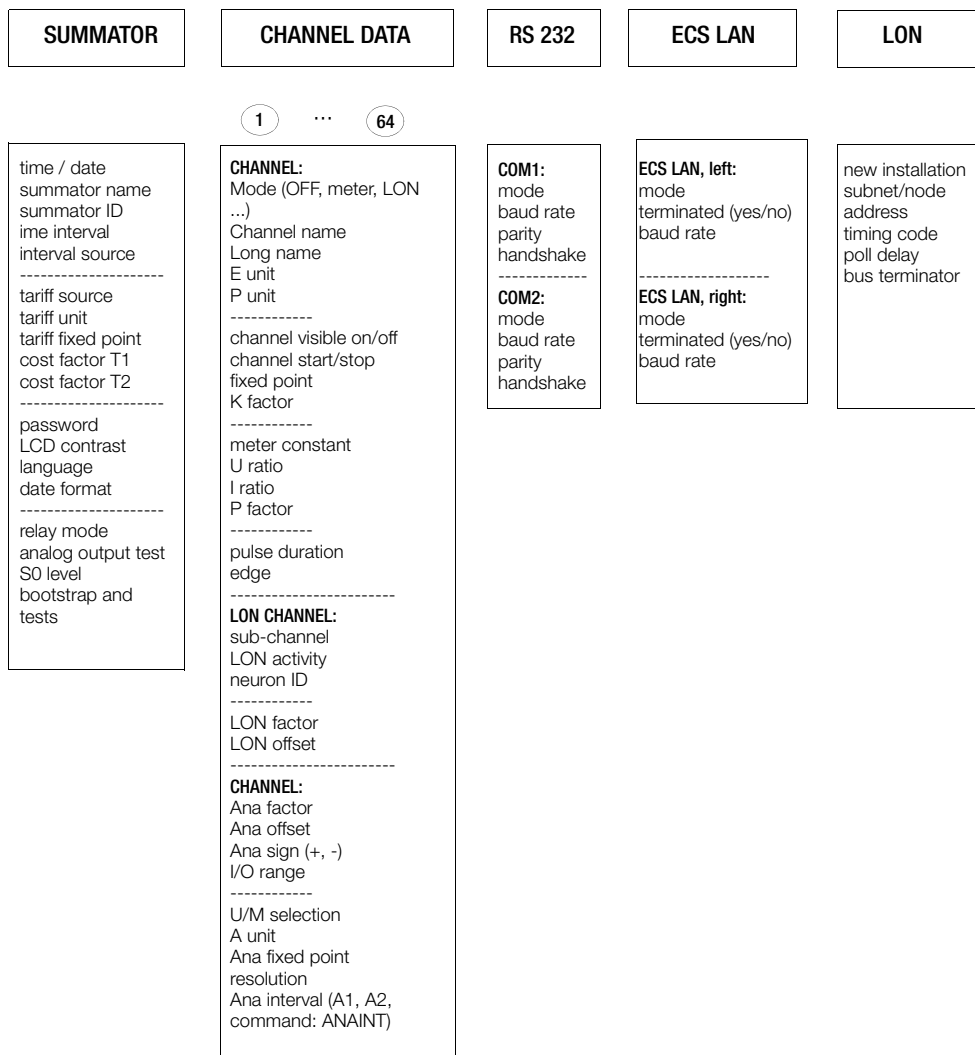


Figure 2 Setup Parameters

U1602, U1603

ECS ENERGY • CONTROL • SYSTEM

Order Information

The following applies to order designations:

- only one designation may be chosen for each given letter.
- if only zeros follow the capital letter in the designation, it need not be included in the order.

Feature		Designation				
U1602 Micro-Summatom	with bus termination, serial interface and LON interface	U1602				
U1603 Mini-Summatom	with bus termination, serial interface and 6 universal inputs, LON interface	U1603				
Auxiliary Power	AC + DC nominal range of use: 85 V ... 264 V DC nominal range of use: 20 V ... 72 V	H1 H2				
Operating Instructions and Commands Reference	German English	W1 W2				

Order Example

Either the feature or the designation can be included in the order.

Feature (clear text)		Designation				
U1603 Summatom	with bus termination, serial interface and 6 universal inputs, LON interface	U1603				
Auxiliary Power	DC nominal range of use: 20 V ... 72 V	H2				
Operating Instructions and Commands Reference	English	W2				

Accessories

Feature		Designation				
Connector Cable	for PC or terminal	GTZ5232000R0001				

Prepared in Germany • Subject to change without notice • A pdf version is available on the internet

 GOSSEN METRAWATT

GMC-I Messtechnik GmbH
Südwestpark 15
90449 Nürnberg • Germany

Phone +49 911 8602-111
Fax +49 911 8602-777
E-Mail info@gossenmetrawatt.com
www.gossenmetrawatt.com